


# DZM2 Interconnect Wiring Diagrams

## Master Slave Interconnections

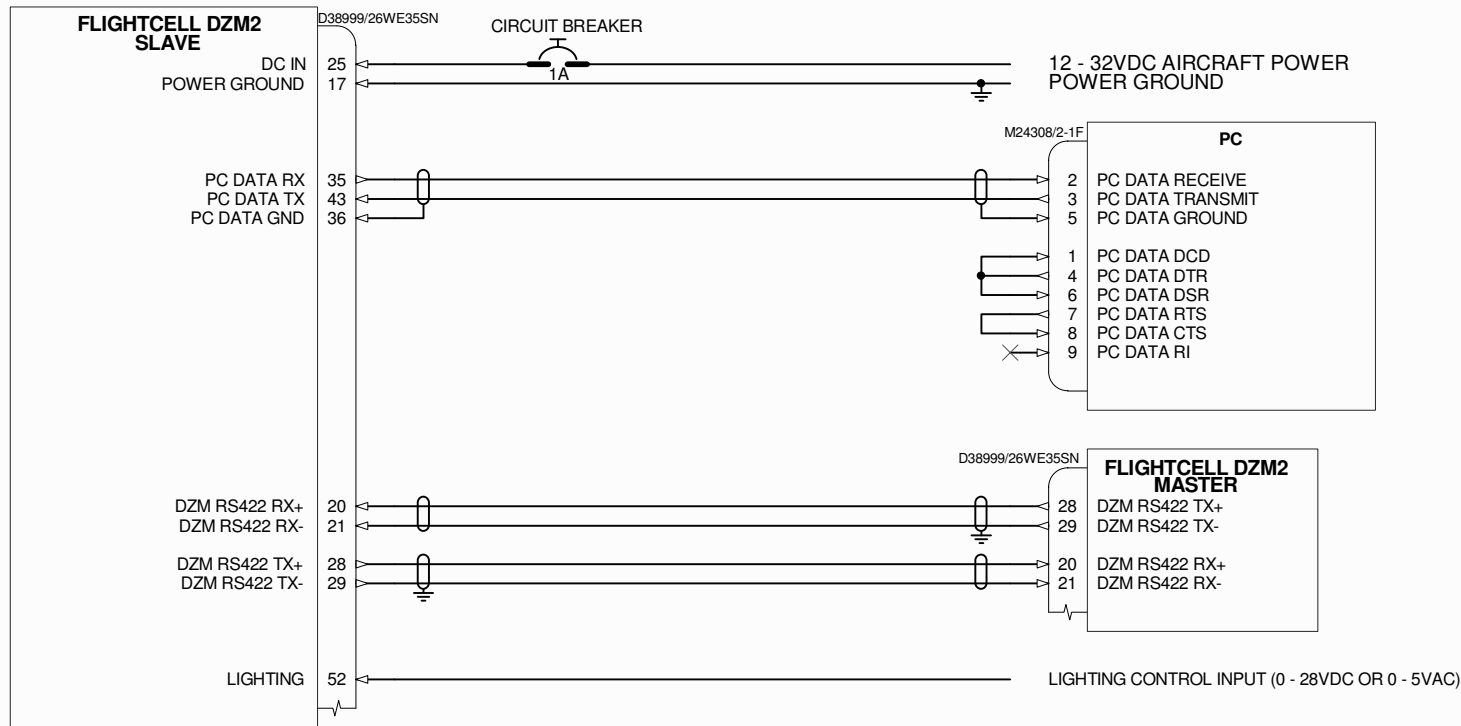

**NOTE:**

The slave unit requires only the connections shown in this drawing.

It is highly recommended that the firmware upgrade port be fitted to facilitate in-situ reprogramming of the slave unit firmware.

The secondary lighting input need be fitted only if the display backlight brightness needs to be controlled externally. Otherwise the brightness can be set to a fixed level via the menus.

**NOTES:**

1. ALL POWER CABLES SHOULD BE 22AWG STRANDED UNLESS OTHERWISE NOTED e.g. M22759/34-22-9  
OTHER CABLES SHOULD BE 22AWG STRANDED, SCREENED WHERE INDICATED e.g. M27500/-24SB2T14.
2. IT IS RECOMMENDED THAT THE POWER GROUND CONNECTIONS BE RUN
3. SYMBOL DESIGNATIONS

SHIELDED PAIR  
SHIELD TERMINATED TO DC GROUND

SHIELDED PAIR  
SHIELD TERMINATED TO DESIGNATED PIN

SHIELDED PAIR  
SHIELD FLOATING

UNIT GROUND

WIRE SPLICE CONNECTION



Flightcell International Limited  
PO Box 1481, Nelson, New Zealand  
Ph:+64 3 545 8652 www.flightcell.com

Product:	Flightcell DZM2			
Sheet:	Master Slave Interconnections	1	of	1
Issue:	1.1			
1.1	C/N FCN0312 - Drawing no added, Shielding scheme updated.	07/03/12	JG	Drawn By: James Glasgow
1.0	Document created (C/N FCN0184).	15/04/11	JG	Filename: Master Slave Interconnections.SchDoc
REV	DESCRIPTION	DATE	APPD	Date: 19/06/2012 Drawing No: WRL DZ2 002