


DZM2 Interconnect Wiring Diagrams

Direct Microphone ICS Interconnections with GMA-340

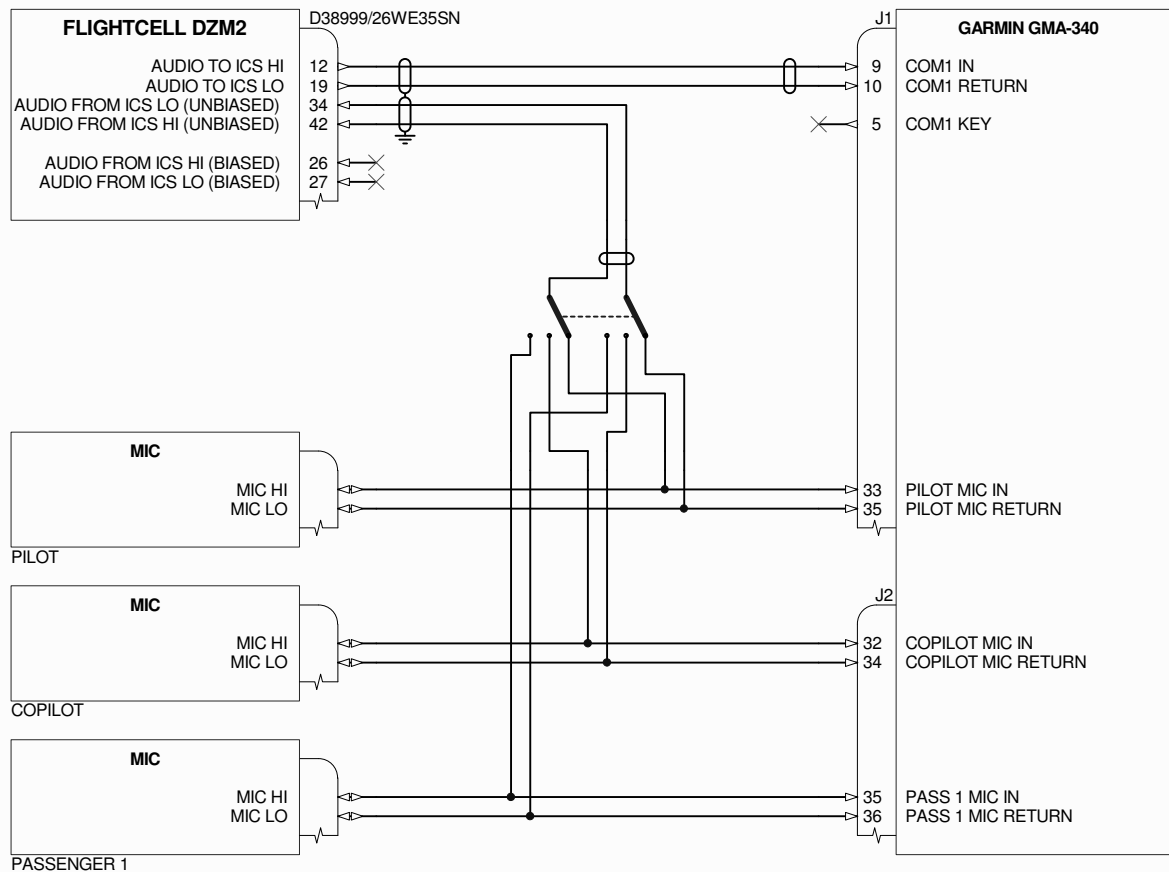

NOTES:

1. ALL POWER CABLES SHOULD BE 22AWG STRANDED UNLESS OTHERWISE NOTED e.g. M22759/34-22-9
OTHER CABLES SHOULD BE 22AWG STRANDED, SCREENED WHERE INDICATED e.g. M27500/-24SB2T14.
2. IT IS RECOMMENDED THAT THE POWER GROUND CONNECTIONS BE RUN
3. SYMBOL DESIGNATIONS

- SHIELDED PAIR
SHIELD TERMINATED TO DC GROUND
- SHIELDED PAIR
SHIELD FLOATING
- UNIT GROUND



Flightcell International Limited
PO Box 1481, Nelson, New Zealand
Ph:+64 3 545 8652 www.flightcell.com

Product:	Flightcell DZM2		
Sheet:	Direct MIC ICS Interconnections 1 of 1		
Issue:	1.1		
1.1	C/N FCN0312 - Drawing no added, Shielding scheme updated.	07/03/12	JG
1.0	Document created (C/N FCN0224).	20/06/11	JG
REV	DESCRIPTION	DATE	APPD
Date:	19/06/2012	Drawing No:	WRL DZ2 004

1

2

3

4

1

2

3

4